


UT12A

Voltage Detector

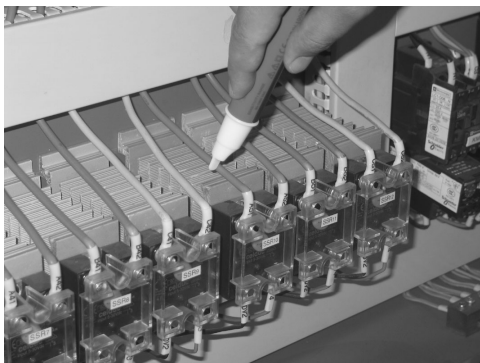

Overview

This Operating Manual covers information on safety and cautions. **Read** and **understand** all of the instructions and safety information in this manual before operating or servicing this tool. Failure to understand how to safely operate this tool could result in an accident causing serious injury or death.

UT12A is intended to check for the presence of AC voltage, signaling the user with a beep and a flashing LED.

Safety Information

This unit complies with the standards EN61010-1, UL61010-1 and CASC 22.1 No. 61010-1 safety measurement requirement: in pollution degree 2, overvoltage category (CAT. IV 1000V)

CAT.IV: Primary supply level, overhead lines, cable systems etc. Some examples include cables, meters, transformers, and other exterior equipment owned by the power utility.

Use the unit only as specified in this operating manual, otherwise the protection provided by the unit may be impaired.

- **Do not use the unit if it is wet, damaged or cannot operate correctly.**
- **Do not apply more than the rated voltage between the probe tip and earth ground.**
- **When the unit working at voltage over 30V in AC, special care should be taken for there is danger of electric shock.**
- **Follow the local countries safety requirements and standards.**

⚠ Warning

- **This unit is only designed for the specialist who has certain technical knowledge to use.**
- **This unit is intended to check for the presence of AC voltage, the voltage range is 90~1000V. Make sure the tested inductor possible voltage range before carrying out checking.**
- **When you cannot sure the tested inductor voltage range, the unit does not have any response. It does not mean the tested inductor does not have dangerous voltage, do not use any part of the body to touch the tested inductor.**
- **When carrying out checking, keep your fingers behind the probe tip finger guards.**

International Electrical Symbols

Symbols used on the Meter and in this manual are explained below:

	Double Insulated
	Warning. Refer to the Operating Manual
	Danger of electric shock
	Conforms to Standards of European Union

Specifications

- Indicators: LED and Beep
- Voltage range: 90VAC ~ 1000VAC
- Measurement Category IV 1000V per IEC61010
- Temperature:
 - Ø Operating: -10~50°C
 - Ø Storage: 10~50°C
- Humidity: ≤95%
- Altitude: 2000m
- Pollution Degree 2
- Battery: 2 x 1.5V AAA

Operation

- 1) Turn the unit on by keep pressing and holding the power button, the red colour LED will light up.
- 2) Place the probe tip on or near the circuit or unit to be tested. Beep and flashing LED indicate the presence of voltage (90VAC to 1000VAC).
- 3) Release the button to turn the unit off.

Battery Indication

The LED will not flash when you turn the unit on or during checking if the battery is less than 2V. The beep sounds will still have but may be weaker.

Maintenance

Battery Replacement

- 1) Disconnect the unit from the circuit.
- 2) One hand holds the unit. Place another hand's thumb on the probe cap as the figure below

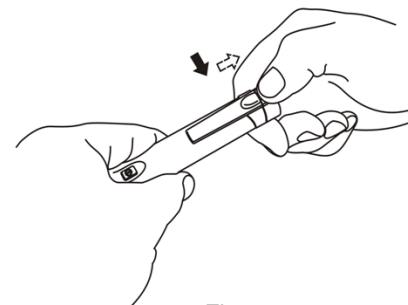


Figure 1

- 3) Pull back the back housing as the figure below

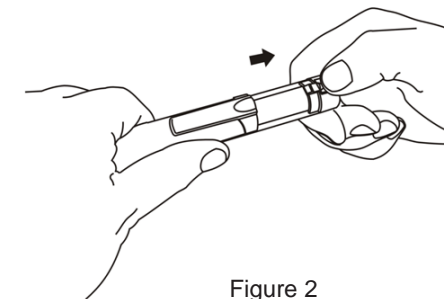


Figure 2

- 4) Replace the batteries (observe polarity).
2 x 1.5V AAA
- 5) Push back the back housing.

Cleaning

Periodically wipe the case with a damp cloth and mild detergent; do not use abrasives or solvents.

END

This operating manual is subject to change without notice.

©Copyright 2007 Uni-Trend Group Limited.
All rights reserved.

Manufacturer:
Uni-Trend Technology (Dongguan) Limited
Dong Fang Da Dao
Bei Shan Dong Fang Industrial Development District
Hu Men Town, Dongguan City
Guang Dong Province
China
Postal Code: 523 925

Headquarters:
Uni-Trend Group Limited
Rm901, 9/F, Nanyang Plaza
57 Hung To Road
Kwun Tong
Kowloon, Hong Kong
Tel: (852) 2950 9168
Fax: (852) 2950 9303
Email: info@uni-trend.com
http://www.uni-trend.com